



W	L	H
5'	4.25'	7/16"
5.5'	3.75'	13/32"
6'	3.73'	3/8"
6.5'	3.41'	11/32"
7.0'	3.10'	5/16"
7.5'	2.78'	9/32"
8.0'	2.46'	1/4"
8.5'	2.15'	7/32"
9.0'	1.83'	3/16"
9.5'	1.51'	5/32"
10'	1.20'	1/8"
10.5'	0.78'	3/32"

PARALLEL CURB RAMP

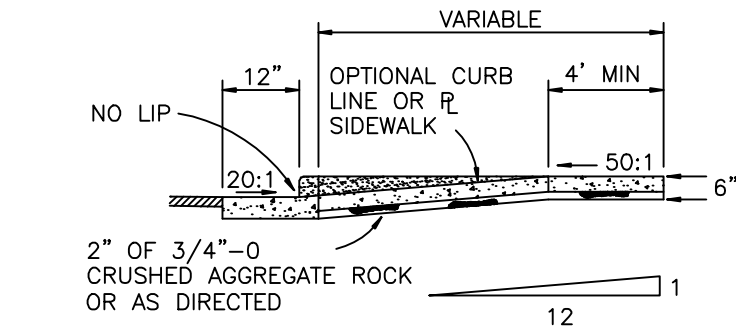

TYP. SECTION THROUGH DETAIL

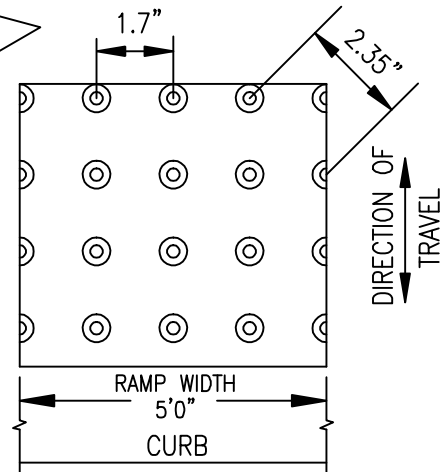

RAMP TEXTURE DETAIL

NOTES:

1. THE "AMERICANS WITH DISABILITIES ACT" REQUIRES THAT ACCESS RAMPS TO SIDEWALKS CONFORM TO ALL FEDERAL GUIDELINES. EXCEPTIONS TO THE REQUIREMENTS IN THIS DRAWING MUST BE APPROVED BY THE ENGINEER AND MUST COMPLY WITH ADA.
2. NO ABOVE GROUND UTILITIES ARE PERMITTED WITHIN RAMP AREA.
3. LANDINGS SHALL BE PLACED AT THE TOP OF EACH RAMP. LANDING SLOPES SHALL NOT EXCEED 50:1 IN ANY DIRECTION. 5% SLOPED LANDING (MAX.) SHALL BE PLACED AT THE BOTTOM OF EACH RAMP.
4. PLACE TRUNCATED DOME DETECTABLE WARNING TEXTURE IN THE LOWER 24" OF THE THROAT OF THE RAMP ONLY. ARRANGE DOMES USING IN-LINE PATTERN ONLY AS SHOWN IN DETAIL. COLOR OF TEXTURE TO BE SAFETY YELLOW. FOR CONSTRUCTION OF SIDEWALK RAMPS OUTSIDE OF PUBLIC RIGHT-OF-WAY, CHECK WITH BUILDING CODES.
5. MINIMUM LANDING DIMENSIONS SHALL BE 4' x 4'.
6. CONCRETE STRENGTH SHALL BE 3300 PSI.



DETAIL FOR PARALLEL SIDEWALK RAMP

DATE:
AUGUST 2009

DRAWING NO.
2